


MT662-2

MOUNTAIN PURE® CERAMIC FILTRATION SYSTEM - STAINLESS STEEL CANISTER

SPECIFICATION SHEET

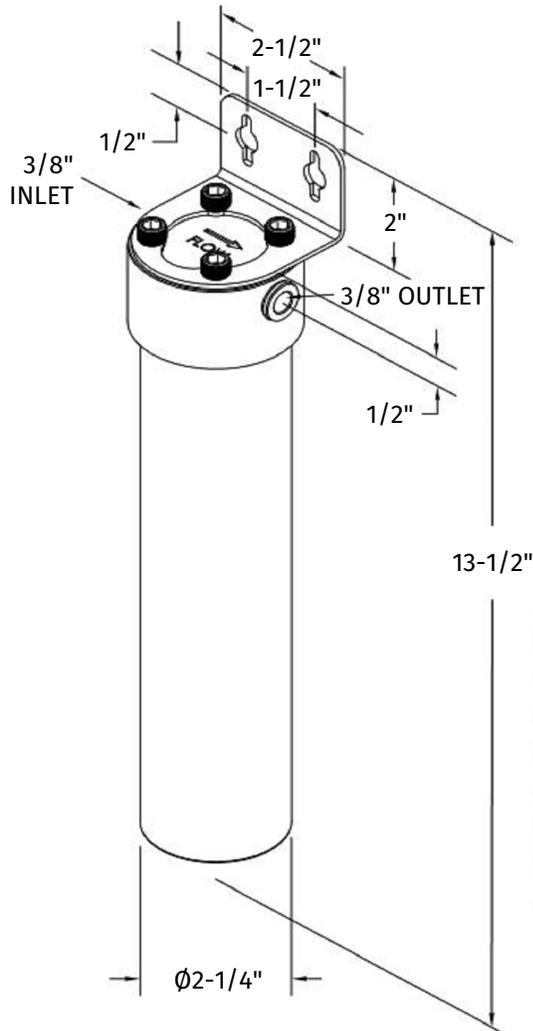

MINIMUM 11" REQUIRED
BETWEEN BOTTOM OF
CANISTER AND BOTTOM
OF CABINET FOR
CARTRIDGE REPLACEMENT

- ALL 304 STAINLESS STEEL COMPONENTS
- INCLUDES MT661/RFC & 3/8" TUBING
- FILTER REMOVES 99.9% OF PARTICLES OVER 5 MICRONS
- FILTER INCORPORATES AN ANTI-MICROBIAL AGENT TO REDUCE BACTERIA
- 1000 GALLON CAPACITY - LASTS 9 MONTHS BASED ON AVERAGE USAGE
- OPERATES WITHOUT WASTING WATER LIKE R.O. FILTERS
- CLEANABLE FILTER ELEMENT MAKES FOR EASY MAINTENANCE
- MAX WORKING PRESSURE: 100PSIG (689KPA)
- MAX WORKING TEMPERATURE 86°F (30°C)
- MIN WORKING PRESSURE 10PSIG (69KPA)
- MIN WORKING TEMPERATURE 41°F (5°C)

IMPURITIES REMOVED:

- | | |
|---------------------------------|------------------------------|
| • PREVENTS SCALE | • ASBESTOS FIBERS |
| • CHLORINE | • OXIDIZED IRON |
| • BAD TASTE/ODORS | • DIRT & DUST |
| • CHLORAMINES | • LEAD |
| • 99.9% OF PARTICLES >5 MICRONS | • TRIHALOMETHANES |
| • GIARDIA LAMBIA CYSTS | • VOLATILE ORGANIC COMPOUNDS |
| • CRYPTOSPORIDIUM CYSTS | • TURBIDITY |
| • MOLDS & AGLAE | • PATHOGENIC BACTERIA |

WARRANTY

FOR WARRANTY INFO PLEASE VISIT WWW.MOUNTAINPLUMBING.COM/PAGE/RESOURCES/WARRANTY

FINISH CARE & MAINTENANCE

NEVER USE ANY HARSH ALKALI, ACID BASED DETERGENTS OR CLEANERS SUCH AS SOFT SCRUB®, SCRUBBING BUBBLES® OR COMET® TO CLEAN. DO NOT USE BRILLO® OR SCOTCH BRITE® PADS. THESE WILL ALL HARM THE FINISH. TO CLEAN, USE ONLY A DAMP SOFT CLOTH AND WIPE GENTLY. STANDARD WINDEX® CAN ALSO BE USED SPARINGLY. IT IS NOT NECESSARY TO WIPE HARD TO REMOVE SPOTS. TO MAINTAIN THE FINISH, WIPE WITH A SOFT DRY CLOTH AFTER USE. AN OCCASIONAL COAT OF PURE CARNAUBA WAX WITHOUT CLEANERS WILL HELP PROTECT THE FINISH.

SPECIFICATIONS SUBJECT TO CHANGE WITHOUT NOTICE

www.mountainplumbing.com 888-222-9140 fax 972-456-2719